

Date : 12/31/2024
Project No : 2021C060
Client Company : Pulte Group
Arrival Time : 12/31/2024 11:00
Onsite Hours : 03:30

ASEC Report ID : 75039
Name of the Project : Suncity - Peachtree
Project Location : Griffin, GA
Weather : Sunny
Departure Time : 12/31/2024 14:30
ASEC Technician Name : Micah Aycock


Our representative was on site to perform a foundation inspection for Lot 56 Pod 21. Dynamic Cone Penetrometer (DCP) testing indicated that the foundations were suitable for a soil bearing pressure of 2,000 psf and concrete placement. In-place rebar was found to meet job specifications for size, spacing and quantity.

Please notify us if you have any questions regarding this report.



Date : 12/31/2024
Project No : 2021C060
Client Company : Pulte Group
Arrival Time : 12/31/2024 11:00
Onsite Hours : 03:30

ASEC Report ID : 75039
Name of the Project : Suncity - Peachtree
Project Location : Griffin, GA
Weather : Sunny
Departure Time : 12/31/2024 14:30
ASEC Technician Name : Micah Aycock

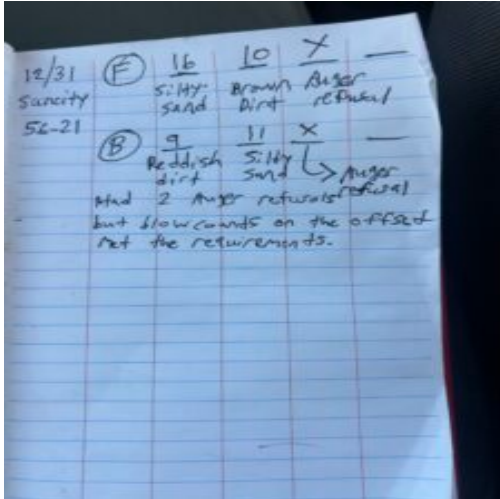

Kenneth Mosman
Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.