

Date : 03/06/2023
Project No : 2022C227
Client Company : Artisan
Arrival Time : 03/06/2023 9:00
Onsite Hours : 06:00

ASEC Report ID : 57503
Name of the Project : Riverwalk Manor (CMT) Unit 2, PH 4E
and 4F
Project Location : Dallas
Weather : Sunny
Departure Time : 03/06/2023 15:00
ASEC Technician Name : Aminullah Azimi

As requested, our AS Engineering and Consulting (ASEC) representative visited the site for the purpose of providing quality control inspection and testing services, visual observation techniques were employed to assure compliance with project drawing/specifications, applicable codes, and materials submittals. The following observations were observed on site this day.

Compaction of fill placed for Lot #58 continued.

At the time of arrival, the contractor had already placed soils and compacted to finished grade. Moisture contents were checked and found to exceed maximum specified limits.

Density testing was performed using a Troxler nuclear gauge (#3430, serial #85759).


Density test results indicate that the compacted material met the project requirement of 90% of the maximum dry density obtained by the (Standard Proctor ASTM 698).

Density testing results:

P-1 Moisture-Density Relationship (proctor) = 100.4 pcf @18.6%

T1-elevation at finish grade@ lot 58, Yd 103.4 M%17.5, Compaction: 102.98 %

T2-elevation at finish grade@ lot 58, Yd 96.1M%19.5, Compaction: 95.7%

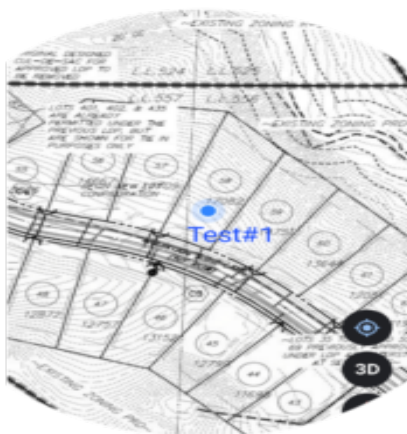

Date : 03/06/2023
Project No : 2022C227
Client Company : Artisan
Arrival Time : 03/06/2023 9:00
Onsite Hours : 06:00

ASEC Report ID : 57503
Name of the Project : Riverwalk Manor (CMT) Unit 2, PH 4E
and 4F
Project Location : Dallas
Weather : Sunny
Departure Time : 03/06/2023 15:00
ASEC Technician Name : Aminullah Azimi



Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.