

Date : 12/19/2024
Project No : 2024C202
Client Company : CCG
Arrival Time : 12/19/2024 07:30
Onsite Hours : 9:00

ASEC Report ID : 74638
Name of the Project : Old Griffin Rd - Hawthorne Reserve
Project Location : Dallas
Weather : Sunny
Departure Time : 12/19/2024 16:30
ASEC Technician Name : Solomon Cherie

Our AS Engineering & Consulting (ASEC) representative arrived on site to observe field activities. The following tasks were performed:

Observed the placement of fill/grading for Lots #73 and the sewer line between Manholes A12 and A13 today. Compaction tests were performed using a nuclear density gauge. Overall, the results of density testing confirmed that fill compaction met the project and ASTM requirements. Results are attached in separate reports.

The detention pond wall footing which was located on soft soils is now reenforced with 31 helical piers to a depth of 30 feet. In addition, retaining wall rebar was found to meet job specifications for size, spacing and quantity.

Please contact us if you have any questions regarding this report or of the density test results.




Picture showing lot 73 at subgrade



Picture depicting lots at subgrade

Date : 12/19/2024
Project No : 2024C202
Client Company : CCG
Arrival Time : 12/19/2024 07:30
Onsite Hours : 9:00


ASEC Report ID : 74638
Name of the Project : Old Griffin Rd - Hawthorne Reserve
Project Location : Dallas
Weather : Sunny
Departure Time : 12/19/2024 16:30
ASEC Technician Name : Solomon Cherie

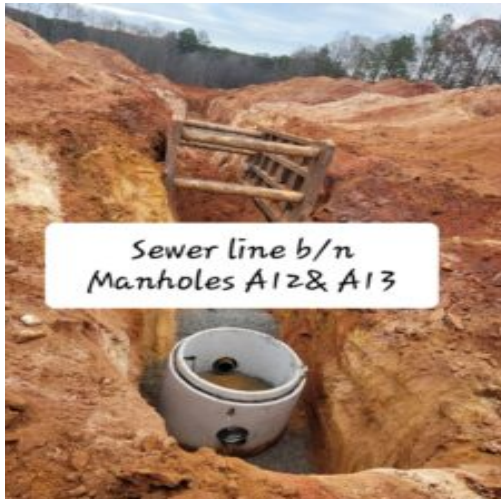

Picture showing a 9.0' deep sewer line



The sewer line after backfilled and packed

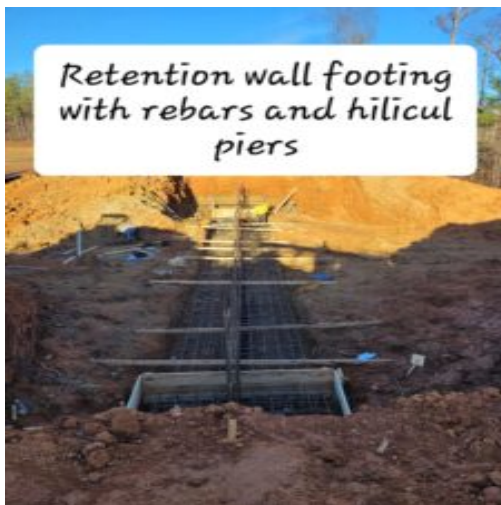

A 76x8 square feet retention wall footing with rebars perfectly put



A closer view of the footing to show the Reenforcing hilicul piers

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.