


Date : 06/09/2026
Project No : 2025C214
Client Company : Artisan
Arrival Time : 06/09/2026 07:30
Onsite Hours : 06:00

ASEC Report ID : 95206
Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
Project Location : Dallas
Weather : Sunny
Departure Time : 06/09/2026 13:30
ASEC Technician Name : Clyde Smith

As requested, the site was visited by our AS Engineering and Consulting (ASEC) representative for the purpose of providing quality control inspection and testing services. Visual observation techniques were employed to verify compliance with project drawing/specifications, applicable codes, and materials submittals. The following observations were observed on site this day.

On the above date our representative was on site to observe and assist observation of the final wall pour for the west side bridge abutment. The wall contractor poured 36 cubic yards of a 5000-psi mix. The writer ordered three extra cylinders to be made for early breaks, two at three days and one at six days. Remaining cylinders will be broken at scheduled dates, 1 @ 7 days, 3 @28 days with 1 reserve.

We appreciate the opportunity to be of service to you on this project. If you have any questions regarding this report, please feel free to contact us. We will be more than happy to discuss it with you.

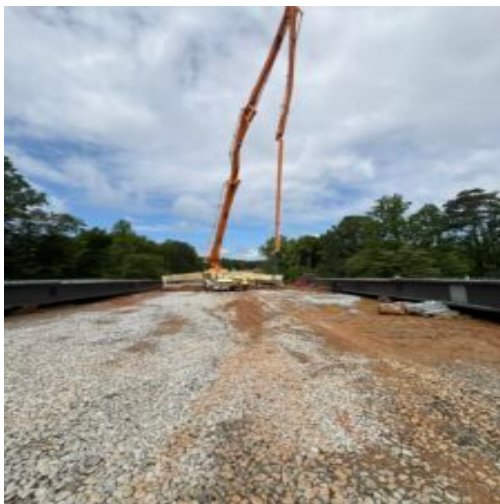

Batch ticket shows 5000 psi mix

Date : 06/09/2026
Project No : 2025C214
Client Company : Artisan
Arrival Time : 06/09/2026 07:30
Onsite Hours : 06:00

ASEC Report ID : 95206
Name of the Project : NW Unit 4 BRIDGE (Materials Testing)
Project Location : Dallas
Weather : Sunny
Departure Time : 06/09/2026 13:30
ASEC Technician Name : Clyde Smith



Performing air test



Performing slump test

Kenneth Mosman

Kenneth Mosman

The results presented in this report relate only to the items tested. This report shall not be reproduced, except in full, without written approval from AS Engineering and Consulting LLC.